


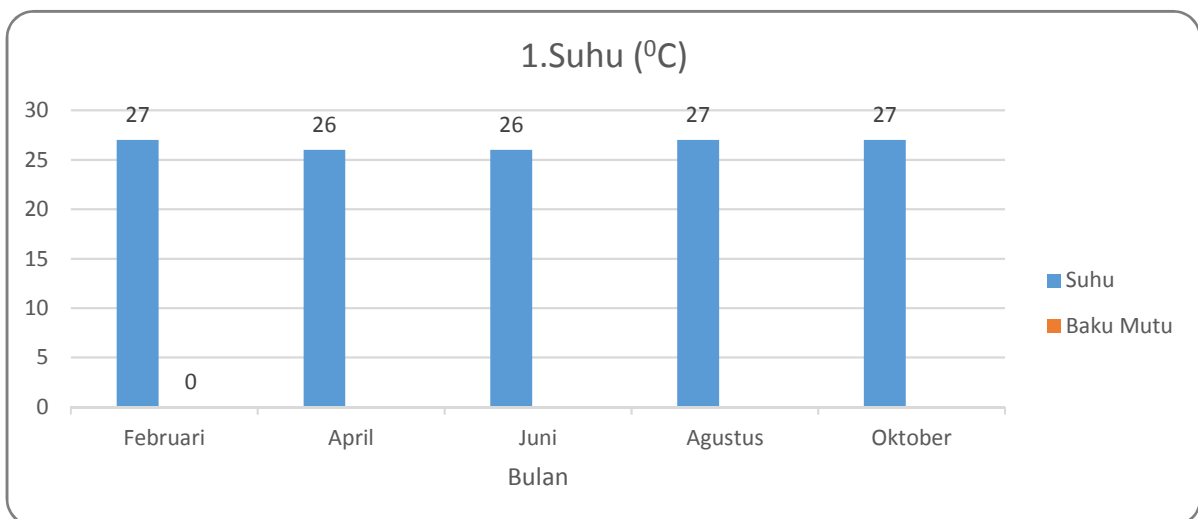
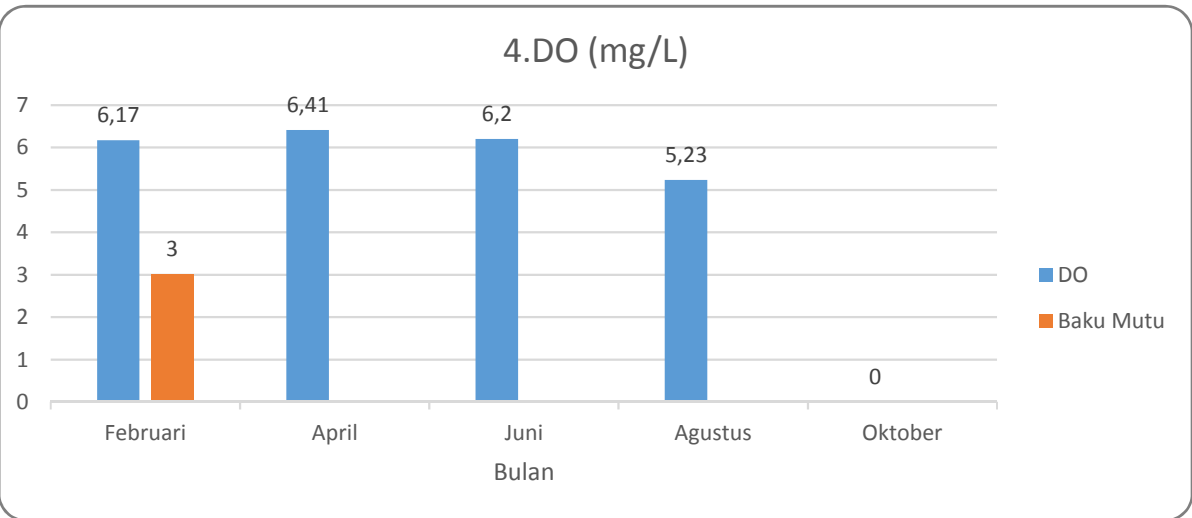
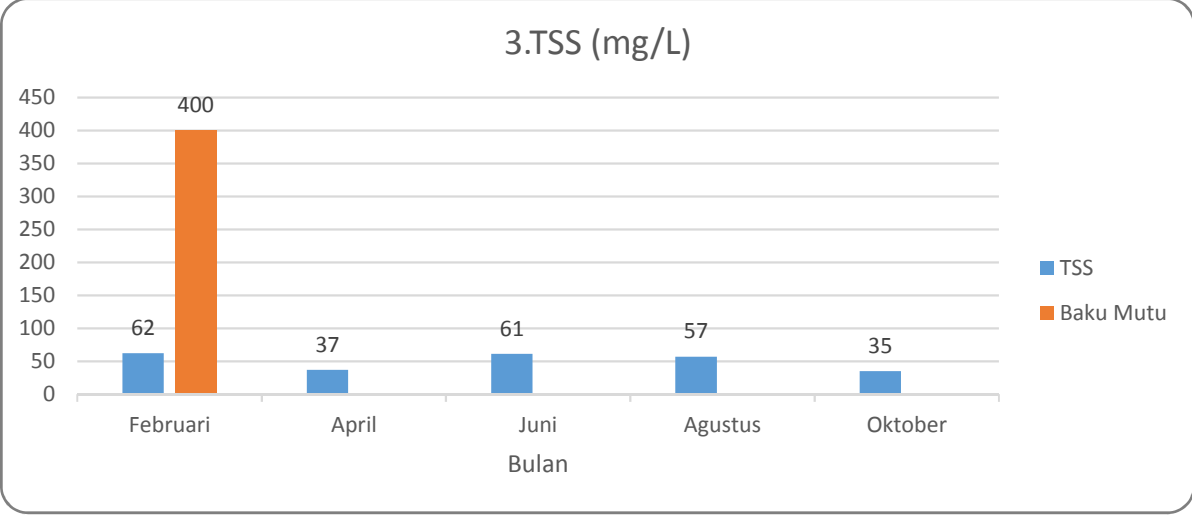
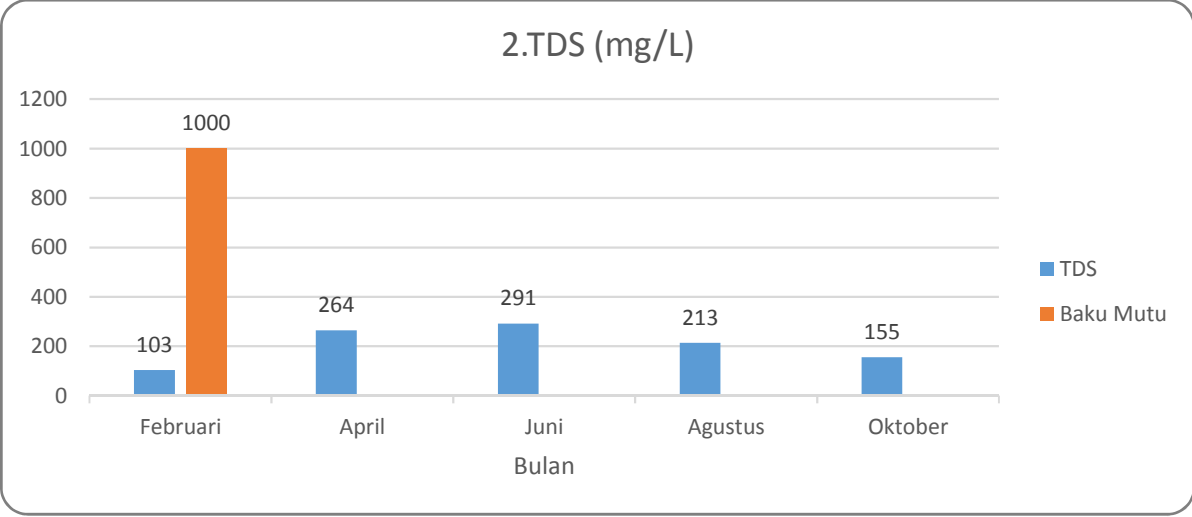


LAPORAN HASIL PENGUJIAN
LABORATORIUM MIPA UNIVERSITAS SEBELAS MARET
Pos Kualitas Air Wd.Cengklik 2014 - S.Pepe


No	Parameter	Satuan	Bulan					Baku Mutu
			Februari	April	Juni	Agustus	Oktober	
1	Suhu	°C	27	26	26	27	27	0
2	TDS	mg/L	103	264	291	213	155	1000
3	TSS	mg/L	62	37	61	57	35	400
4	DO	mg/L	6,17	6,41	6,2	5,23	-	3
5	pH	mg/L	7,56	7,4	7,64	7,58	7,37	9
6	Fe	mg/L	1,52	2,842	0,471	0,284	0,883	1
7	Mn	mg/L	0,217	0,443	0,171	0,061	0,695	1
8	Cd	mg/L	< 0,001	< 0,001	< 0,001	< 0,001	< 0,001	0,001
9	Zn	mg/L	0,018	0,007	0,058	0,058	< 0,003	0,05
10	Pb	mg/L	< 0,005	< 0,005	< 0,006	< 0,006	< 0,006	0,03
11	Cu	mg/L	< 0,004	< 0,004	< 0,001	< 0,001	< 0,001	0,02
12	Cr ⁶⁺	mg/L	< 0,003	< 0,003	< 0,003	< 0,003	< 0,003	0,05
13	Nitrat	mg/L	0	0	0	0	0	20
14	Nitrit	mg/L	0,035	0,112	0,03	0,019	0,03	0,06
15	NH ₃	mg/L	0,004	0,0019	0,002	0,002	0,002	1
16	PO ₄	mg/L	0,101	0,215	0,117	0,075	0,048	1
17	COD	mg/L	3,33	2,745	8,17	16,29	15,91	50
18	BOD	mg/L	2,04	1,4	2,9	5,8	5,93	6
19	Cl	mg/L	7,012	12,75	16,71	16,59	11,24	1
20	Sianida	mg/L	< 0,001	< 0,001	< 0,001	< 0,001	< 0,001	1
21	Sulfida	mg/L	108,04	38,7	19,21	29,9	24,21	1
22	Total Kolifom	jml / 100 mL	2400	2600	2500	460	2500	2400

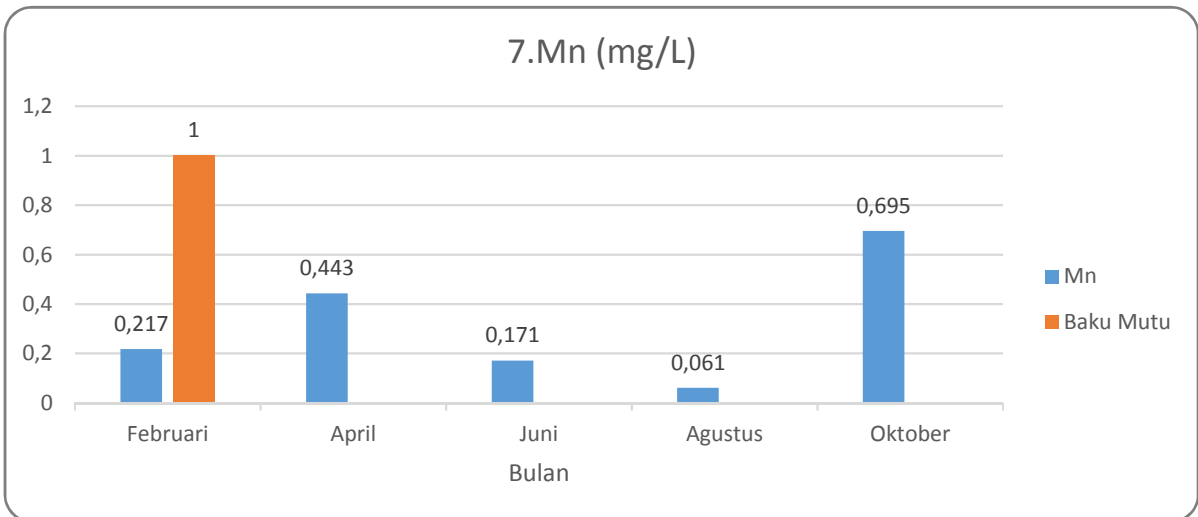

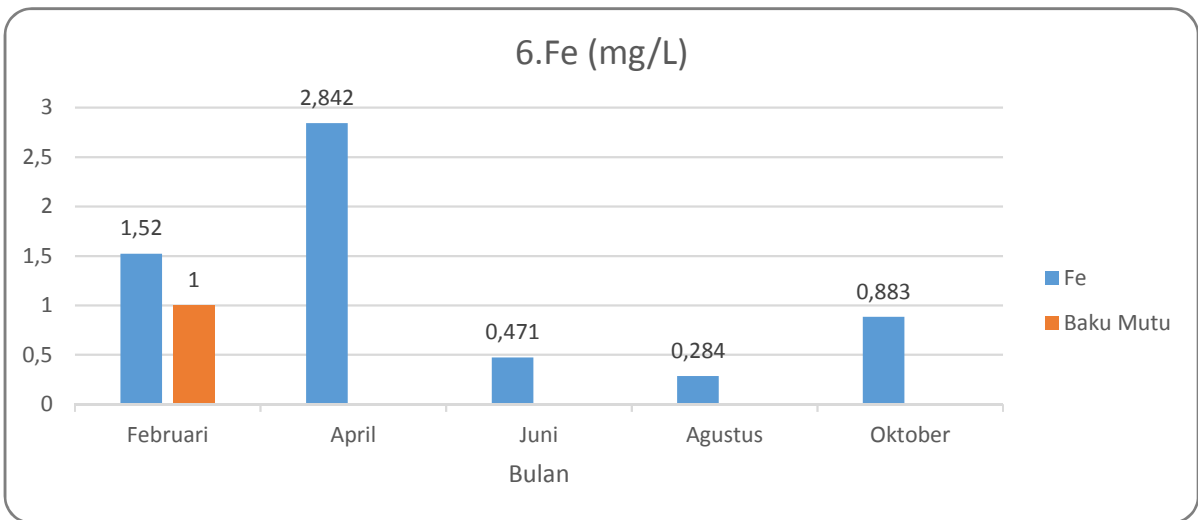


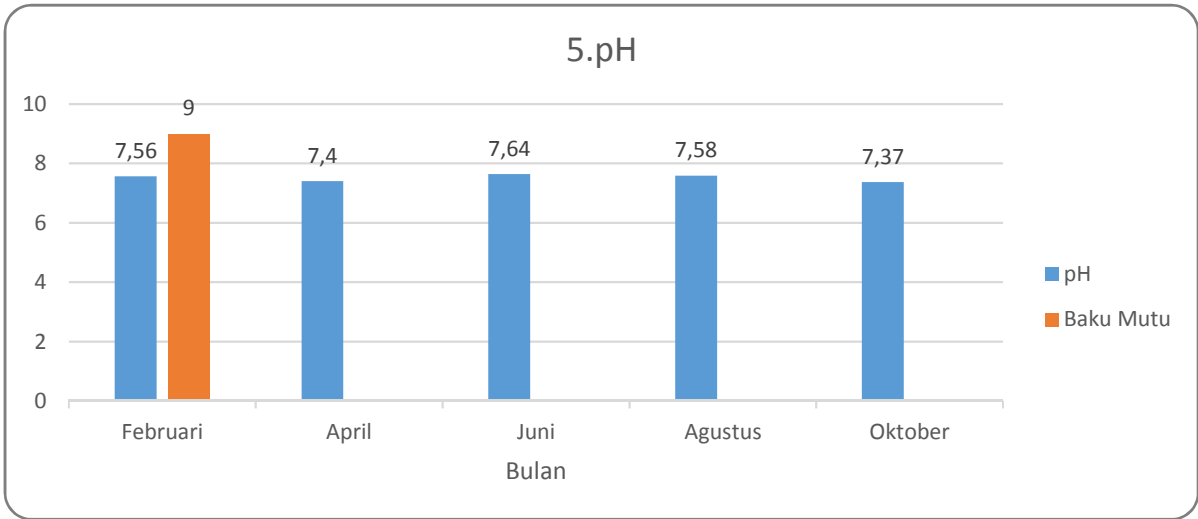


9.Zn (mg/L)

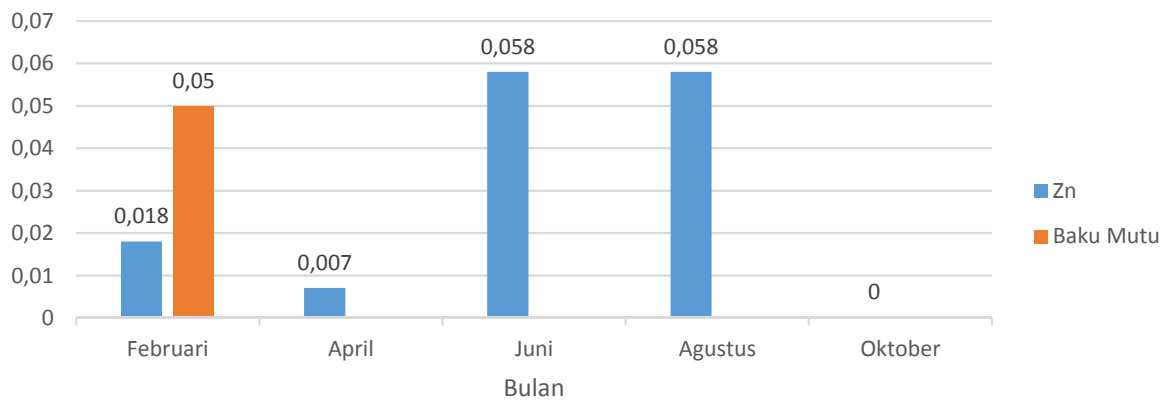


12.Cr (mg/L)

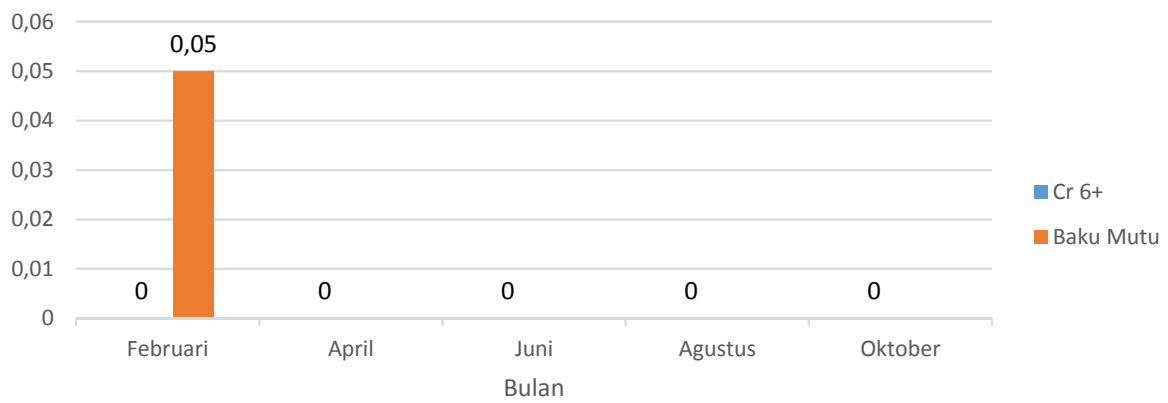


14.Nitrit (mg/L)

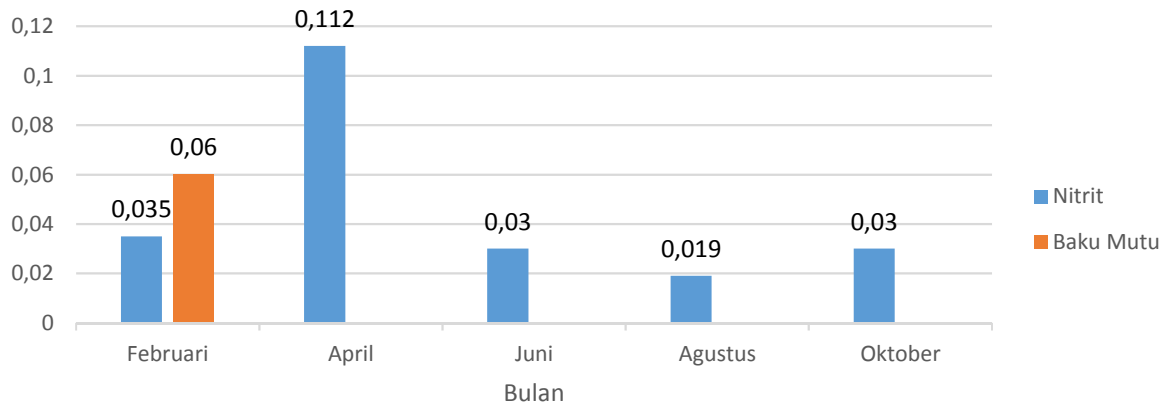


15.NH₃ (mg/L)

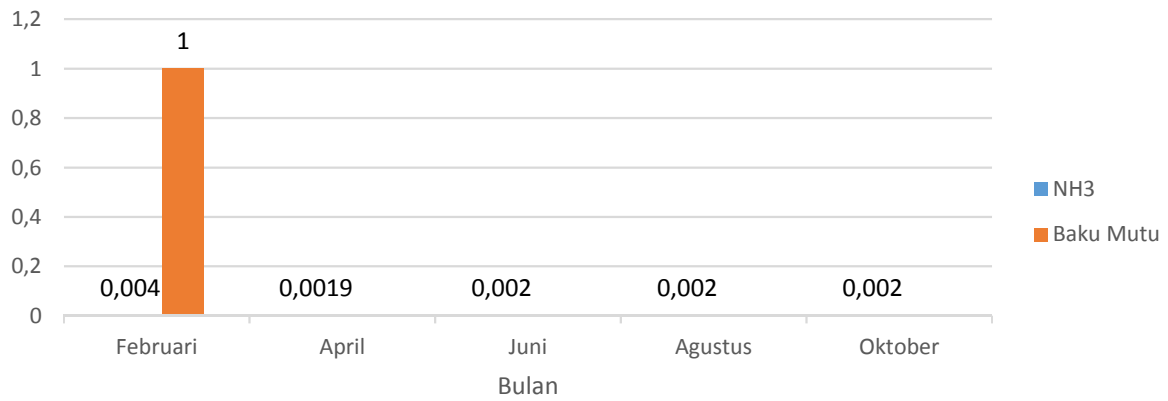


16.PO₄ (mg/L)

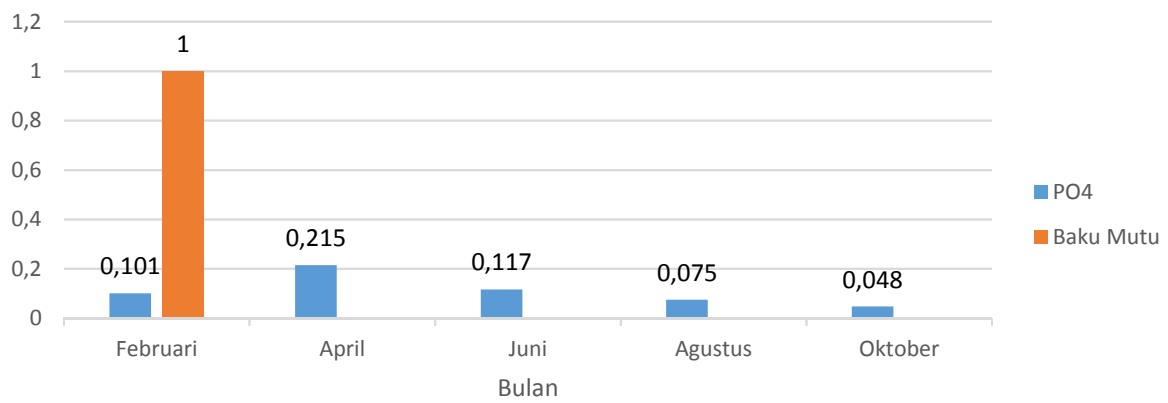


17.COD (mg/L)

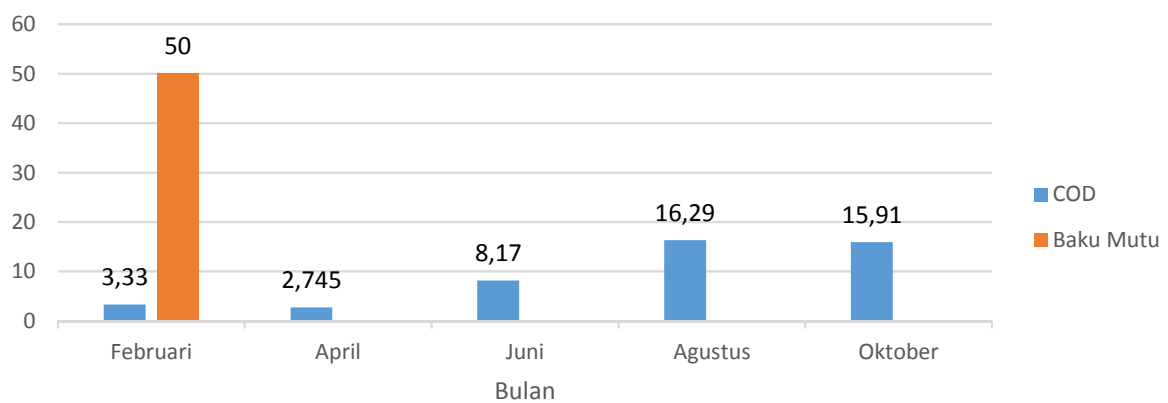


18.BOD (mg/L)

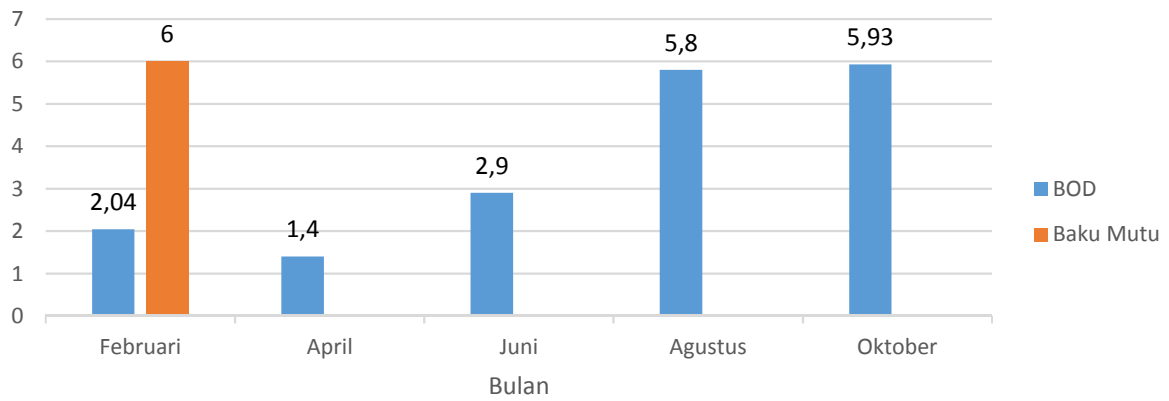


19.Cl (mg/L)

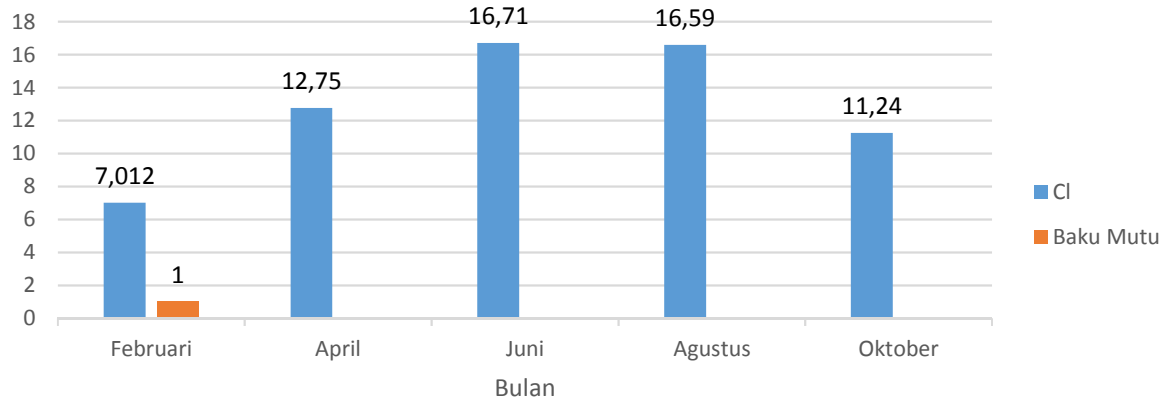

20.CN (mg/L)

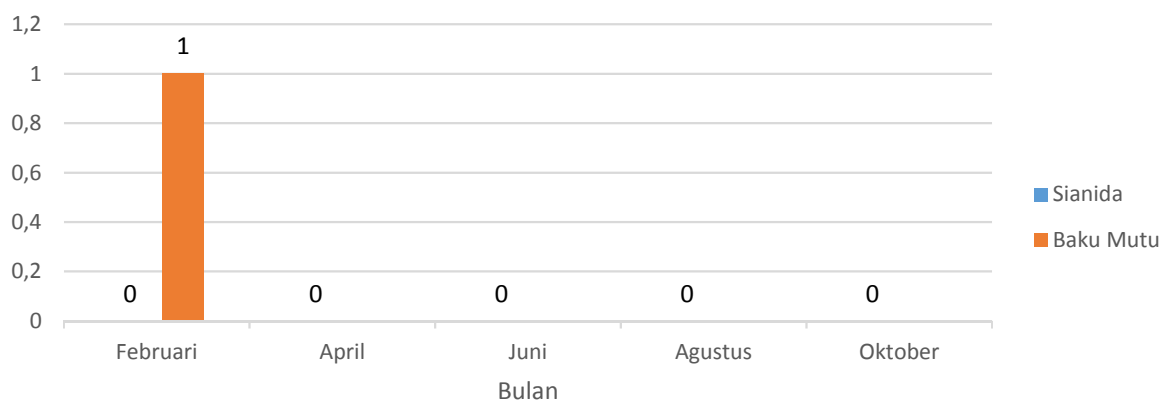

21.Sulfida (mg/L)

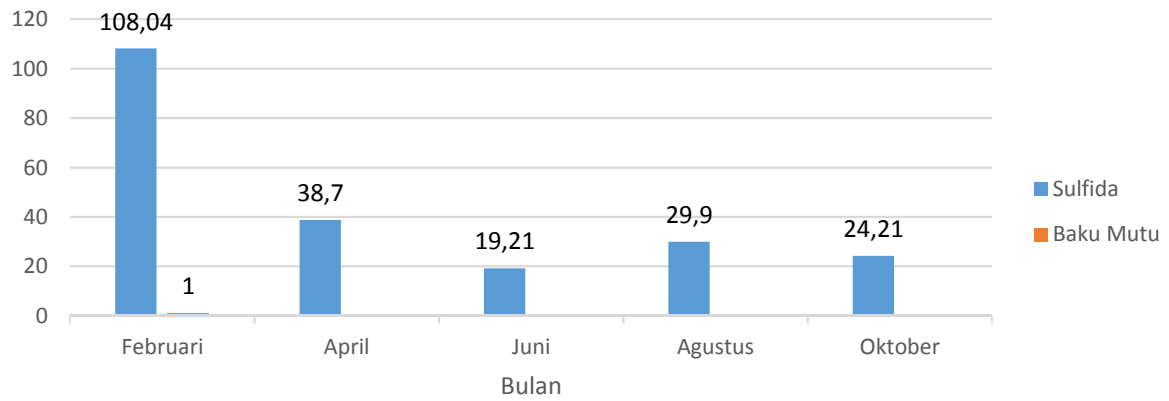

22.Coliform total (jml/100 mL)

