

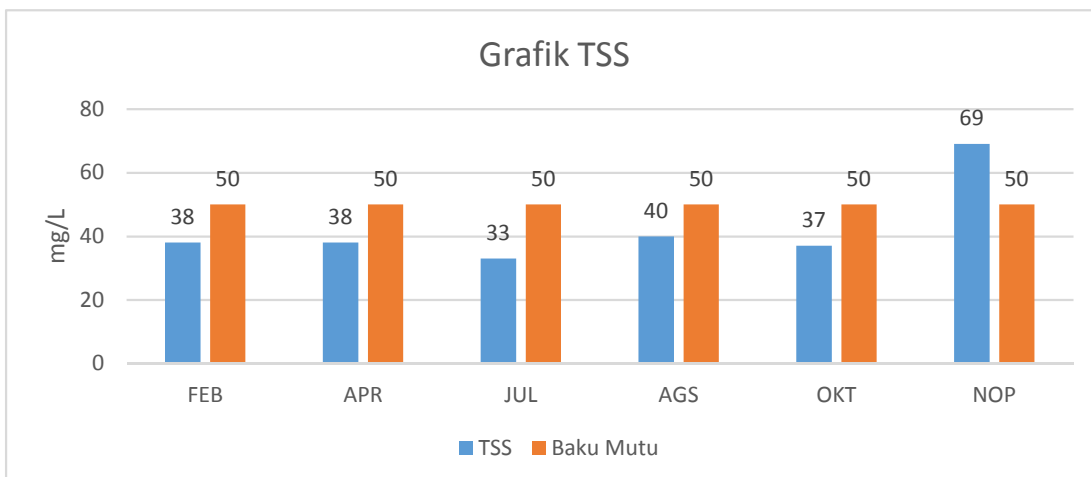
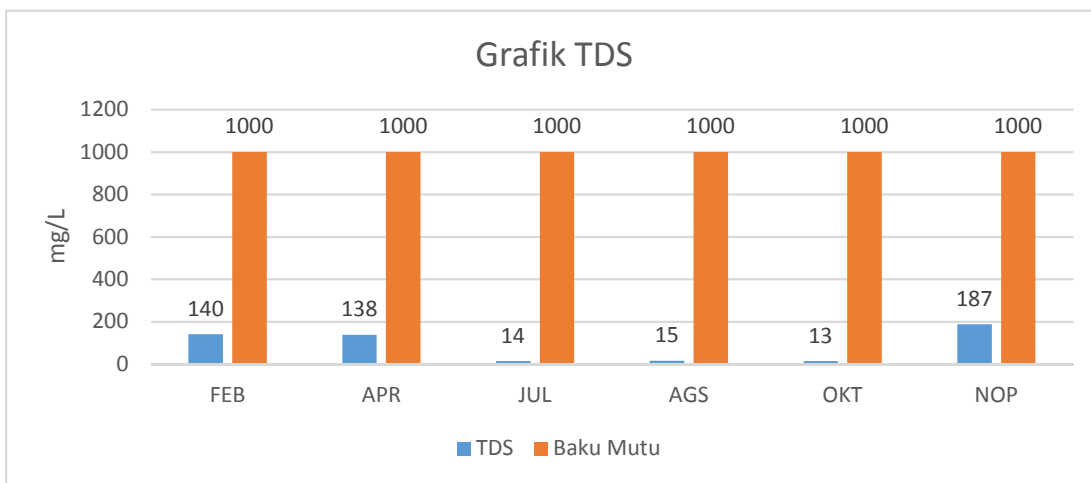
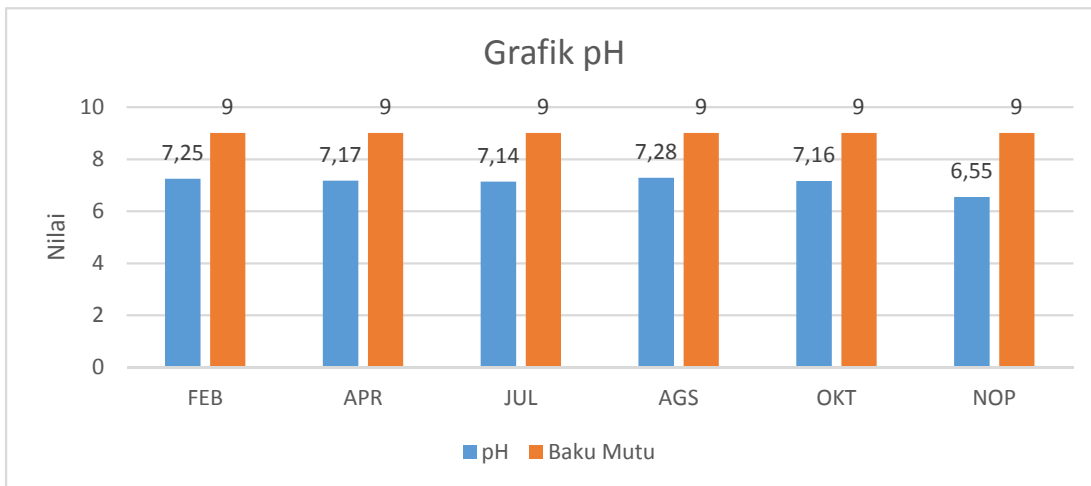
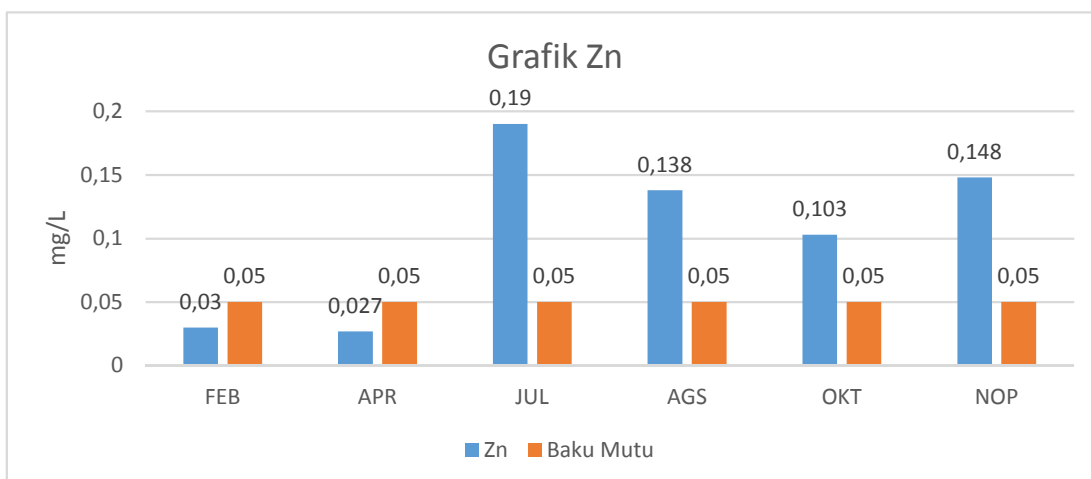


GRAFIK PARAMETER POS KUALITAS AIR WD.CENGLIK - S.PEPE 2018




	pH		TDS		TSS	
FEB	7,25	9	140	1000	38	50
APR	7,17	9	138	1000	38	50
JUL	7,14	9	14	1000	33	50
AGS	7,28	9	15	1000	40	50
OKT	7,16	9	13	1000	37	50
NOP	6,55	9	187	1000	69	50

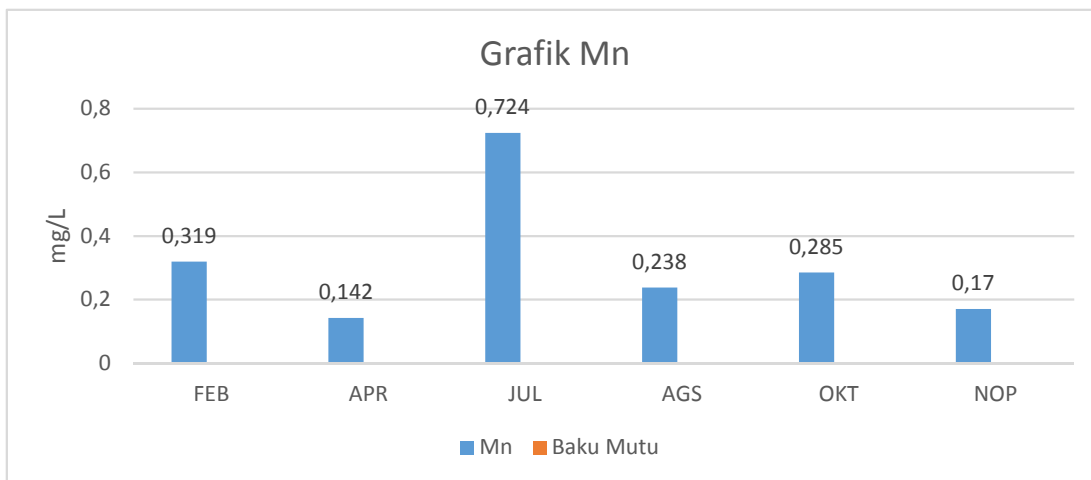




	Fe	Mn	Zn	
FEB	1,984	0,319	0,03	0,05
APR	0,480	0,142	0,027	0,05
JUL	0,698	0,724	0,19	0,05
AGS	0,445	0,238	0,138	0,05
OKT	0,580	0,285	0,103	0,05
NOP	0,409	0,17	0,148	0,05

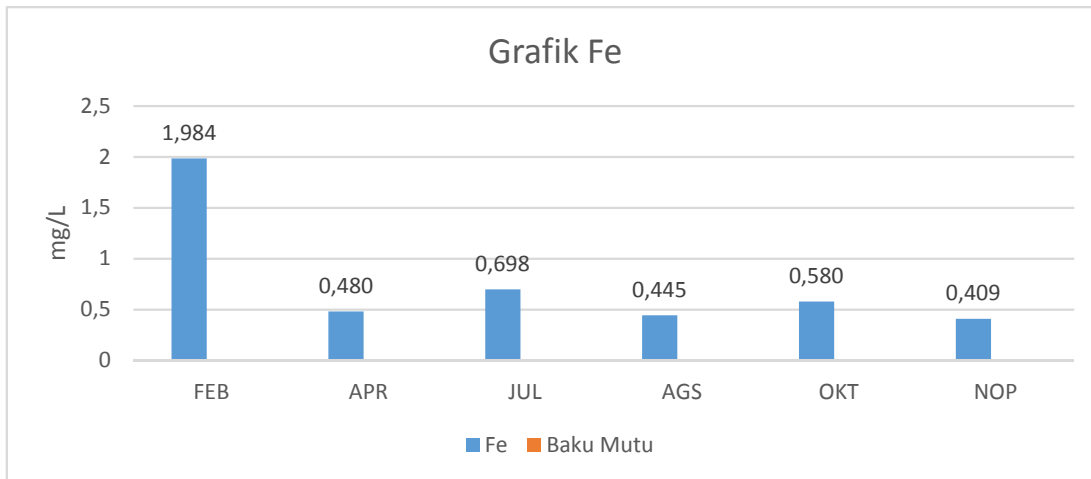




	Cd		Pb		Cu	
FEB	0,001	0,01	0,006	0,03	0,001	0,02
APR	0,001	0,01	0,006	0,03	0,001	0,02
JUL	0,001	0,01	0,006	0,03	0,001	0,02
AGS	0,001	0,01	0,006	0,03	0,001	0,02
OKT	0,001	0,01	0,006	0,03	0,001	0,02
NOP	0,001	0,01	0,006	0,03	0,001	0,02

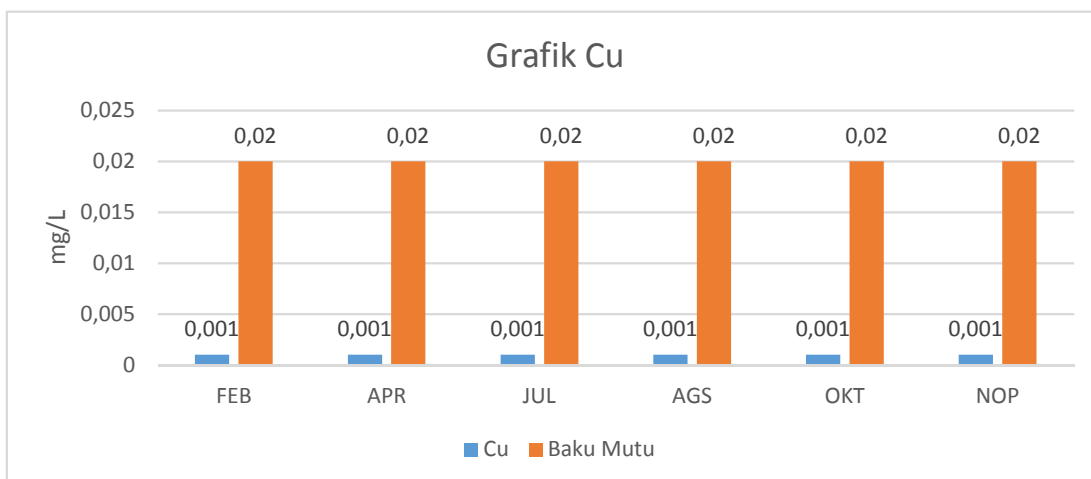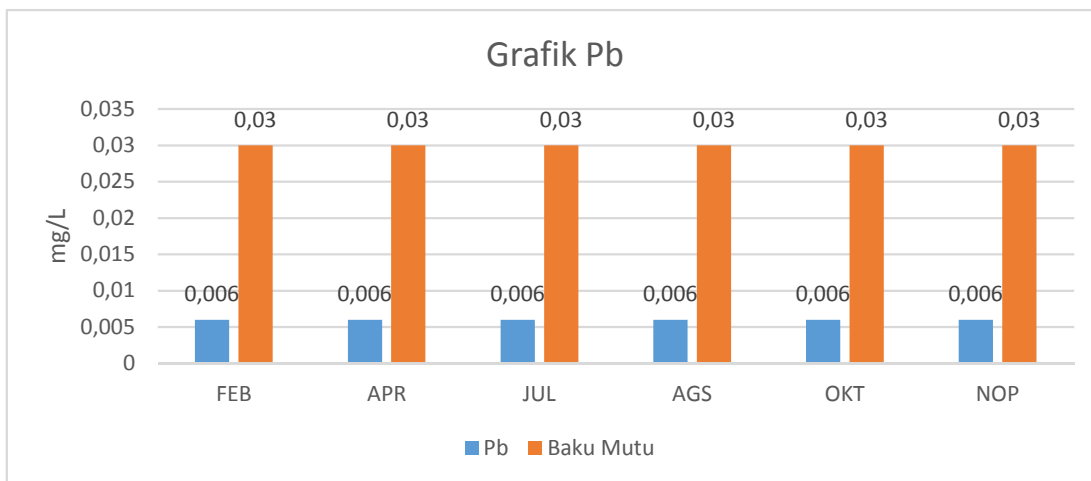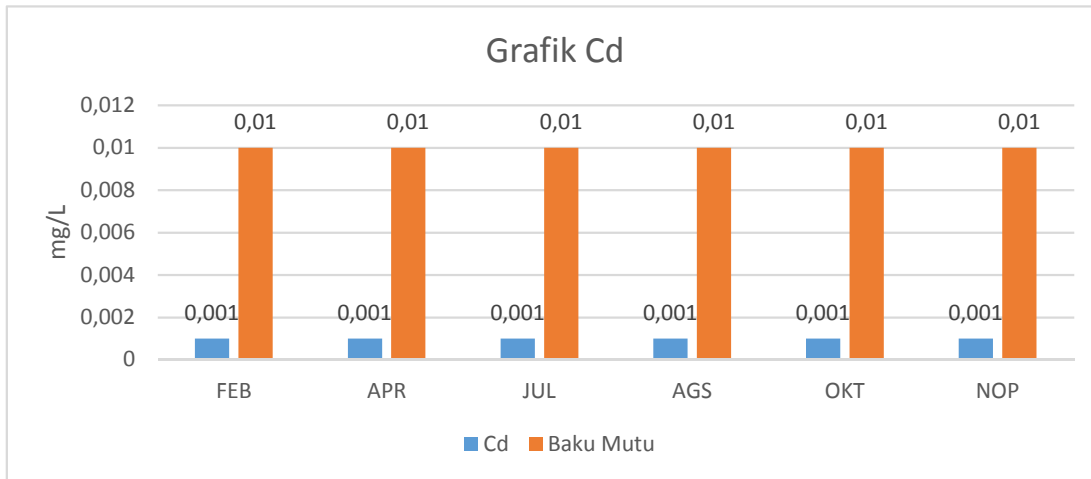




	Cr heksa		NO ₃		NO ₂	
FEB	< 0.003	0,05	0	10	0,091	0,06
APR	< 0.003	0,05	0	10	0,008	0,06
JUL	< 0.003	0,05	0	10	0,017	0,06
AGS	< 0.003	0,05	0	10	0,006	0,06
OKT	< 0.003	0,05	0	10	0,011	0,06
NOP	0,003	0,05	0	10	0,024	0,06

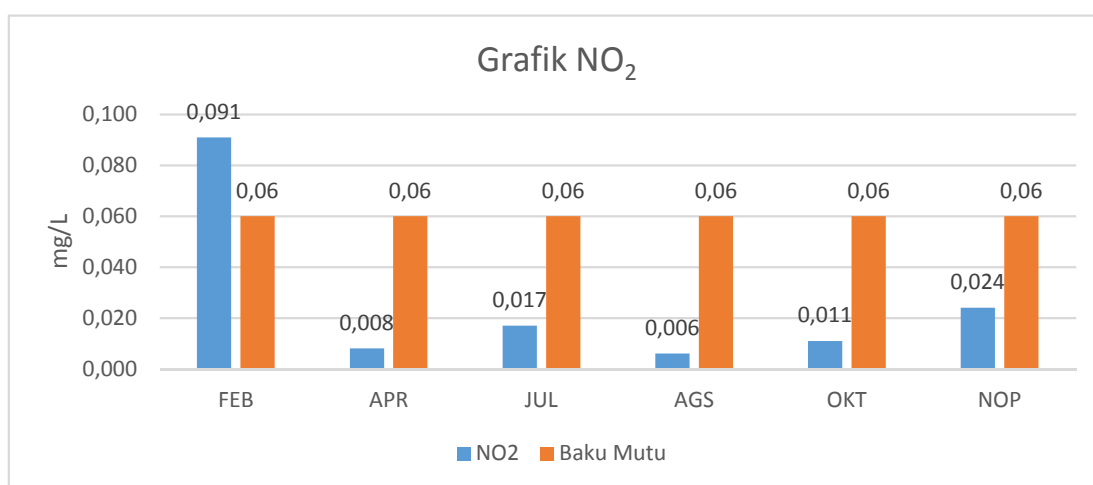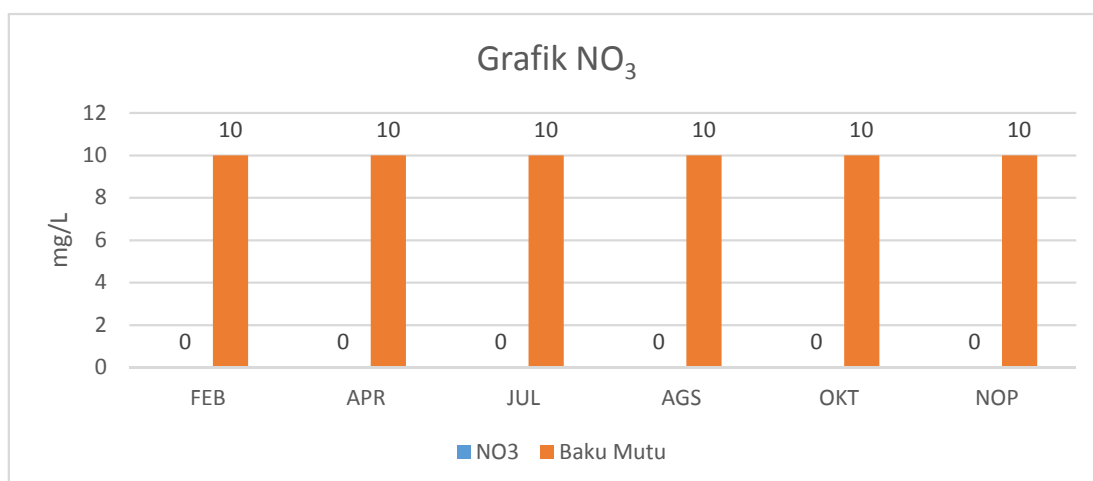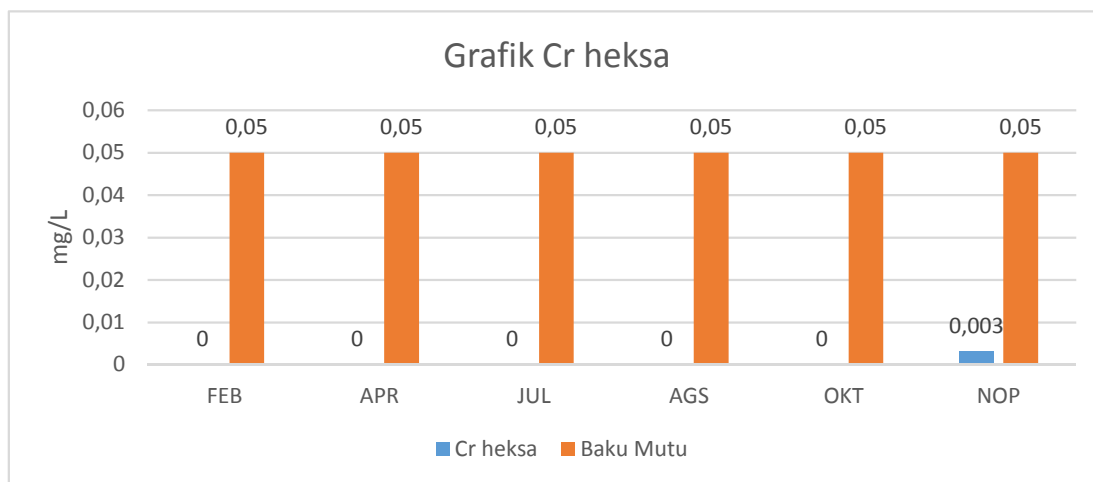

	NH ₃	PO ₄	COD
FEB	< 0,002	0,193	37,43
APR	< 0,002	0,191	31,26
JUL	0,002	0	25,31
AGS	0,005	0	32,32
OKT	0,003	0,147	16,89
NOP	< 0,002	0,155	43,09

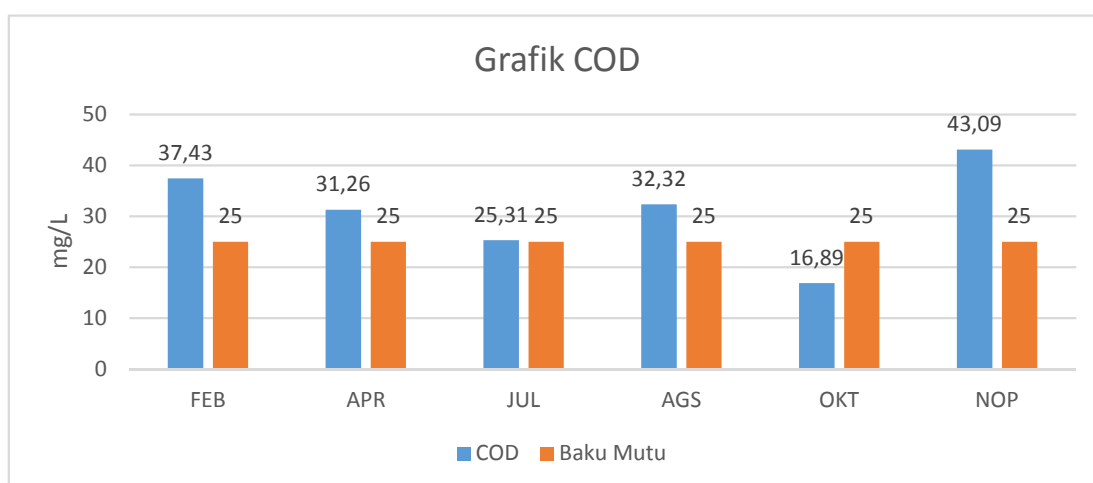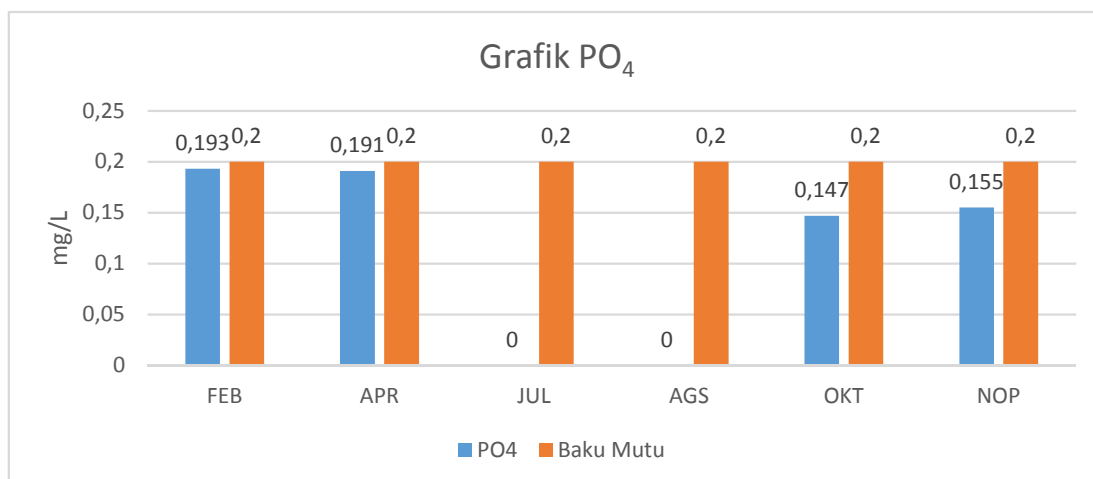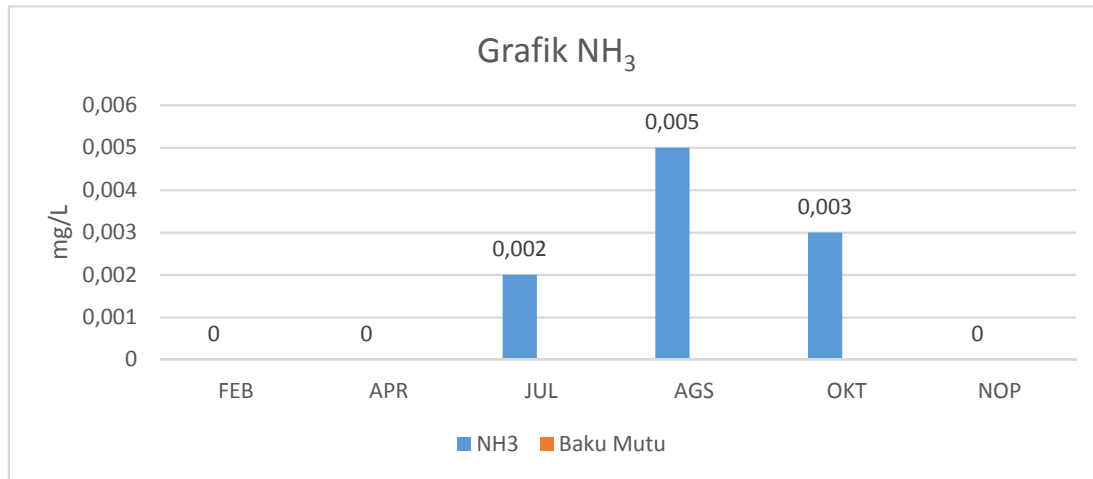

	BOD		Cl	Ni	
FEB	10,54	3	9,02	< 0.001	0,02
APR	6,3	3	16,53	< 0.001	0,02
JUL	6,77	3	19,82	< 0.001	0,02
AGS	7,98	3	15,8	< 0.001	0,02
OKT	5,14	3	28,99	< 0.001	0,02
NOP	11	3	20,07	< 0.001	0,02

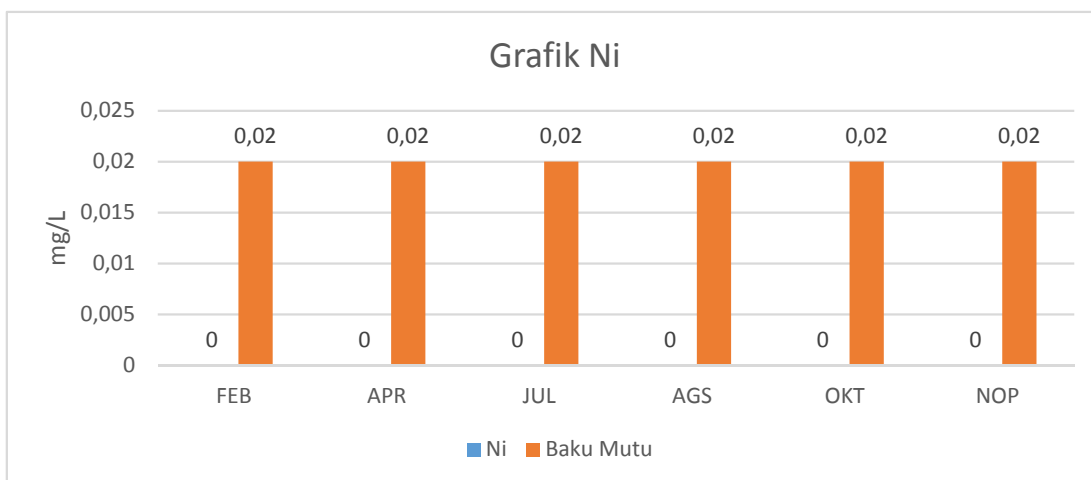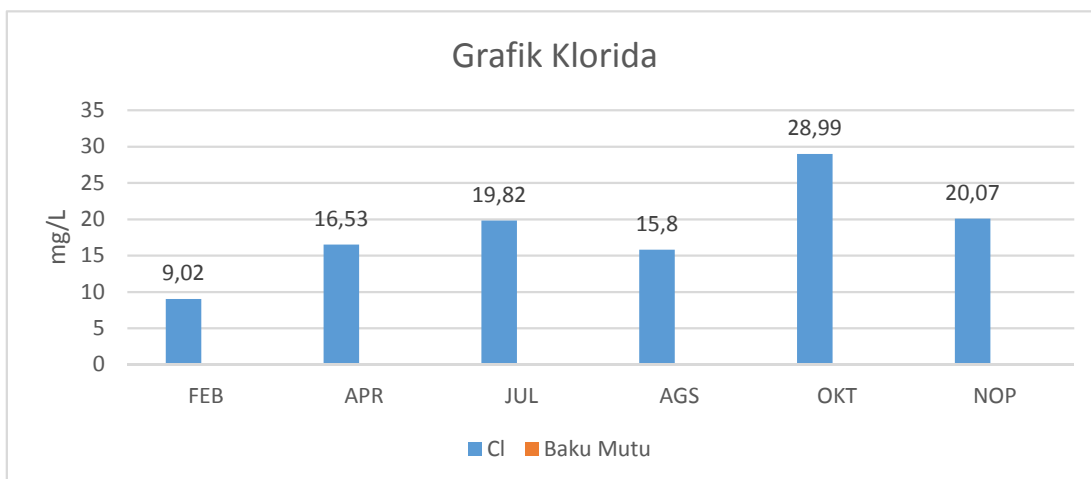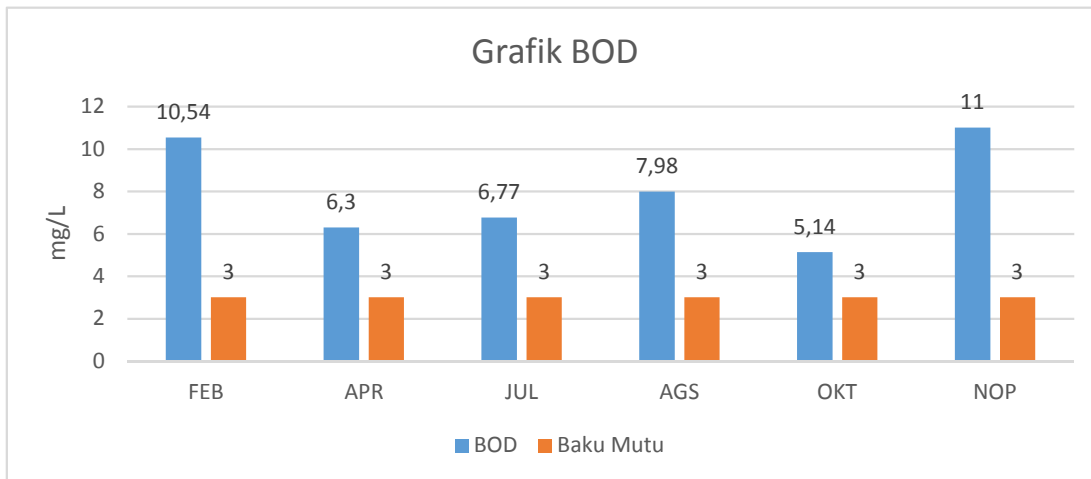

	Ca	Sulfida	Coliform		
FEB	34,57	0,06	0	2	5000
APR	0,001	0	0	0,3	5000
JUL	0,001	0,225	0	0	5000
AGS	0,001	0,016	0	0	5000
OKT	0,001	0,009	0	0	5000
NOP	38,96	0,242	0	0,007	5000

